

GESTRA Steam Systems

Product Range B1

Level Switch

NRS 1-8
**Self-Monitoring High-Level Alarm with
Periodic Self-Checking Routine to DIN VDE 0116**
NRS 1-8

Specification

Self-monitoring high-level alarm with periodic self-checking routine, in combination with GESTRA level electrode type NRG 16-12, PN 40, NRG 17-12, PN 63, or NRG 19-12, PN 160. The equipment combination detects the max. water level (high-level alarm).

The equipment meets the German regulations for use in steam-boiler plants operating according to TRD 602 and TRD 604 sheets 1 + 2 and EN 12952 and EN 12953.

Design

NRS 1-8

Plug-in unit in plastic case for installation in control cabinets. The terminals in the case are accessible after loosening two screws and unplugging the unit from its base.

To avoid confusion with other plug-in units of the GESTRA range, inserts are fitted in the bases so that only the correct unit may be plugged into each base.

The plug-in units may be snapped onto a 35 mm supporting rail or screwed into position on a mounting panel.

Operation

The level switch type NRS 1-8 is a two-channel unit provided with an automatic self-checking circuitry in accordance with DIN VDE 0116 (directives for protection circuits). The self-checking is effected periodically. The test includes the checking of the cable between electrode and level switch and of the self-checking circuitry (redundancy). The output relays are not influenced by the internal tests.

In addition to this self-checking, the level switch can also be tested manually by pushing the button "TEST 1" simulating a defect in the electrode. The test switch "TEST 2/INSPECTION" is provided for checking the function of the checking circuitry.

As the circuit of the relay contacts of the level switch is normally closed, alarm will also be signalled in the event of a mains failure.

The level switch can signal the following three operating conditions:

- Normal operation (correct level)
- Alarm (high level)
- Alarm (malfunction in level switch or electrode)

The green LED indicates power supply. The high level or malfunction alarm is indicated by two red LEDs. The failure of one channel (loss of redundancy) is signalled by the illumination of a single red LED.

The combination of electrode NRG 16-12, NRG 17-12, or NRG 19-12 and level switch NRS 1-8 provides fail-safe protection against a first fault, i.e. the system will still continue to provide the safety function even after the occurrence of a first fault.

System Components

Level electrode NRG 16-12, PN 40, NRG 17-12, PN 63, NRG 19-12, PN 160 as high-level alarm.

Technical Data

Type-approval no.

09 - 91 - 0112

Input

Three terminals for the connection of one level-control electrode type

NRG 16-12, PN 40

NRG 17-12, PN 63

NRG 19-12, PN 160.

Output

Two volt-free relay contacts (mounted in series in the case of design "b");
max. contact rating: 250 V, 300 W, 3 A resistive with a life of 5×10^5 switching cycles or 0.35 A inductive with a life of 2×10^6 cycles;
contact material silver, hard-gold plated

Delay of response

Default factory setting: 3 s
(up to 25 s possible)

Sensitivity

10 $\mu\text{S}/\text{cm}$ at 25 °C when used in conjunction with level electrode without measuring surface extension (cell constant $C = 0.3$).

0.5 $\mu\text{S}/\text{cm}$ at 25 °C when used in conjunction with level electrode with measuring surface extension (cell constant $C = 0.13$), see data sheet NRG 16-12.

Indicators and adjustors

Two LEDs "Alarm"

One LED "Operation"

One button "TEST 1"

One switch "TEST 2/INSPECTION".

Mains supply

230 V $\pm 10\%$, 50/60 Hz

(please state voltage when ordering).

Special voltage: 115 V $\pm 10\%$, 50/60 Hz or 24 V $\pm 10\%$, 50/60 Hz; 24 V d.c. supply also possible with the inverter type URN-1.

Power consumption

5 VA

Protection

Design NRS 1-8 IP 40 to EN 60529

Permissible ambient temperature

0 °C to 55 °C

Case materials


Base: Noryl SE 1-GFN 2 UL 94 VO, black

Cover: R-ABS UL 94 VO, stone grey

Approx. weight

0.6 kg

CE marking 0525

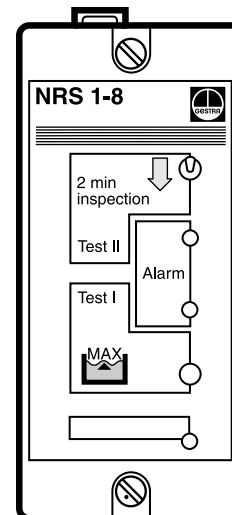

Level switch NRS 1-8

Level Switch

NRS 1-8

Self-Monitoring High-Level Alarm with Periodic Self-Checking Routine to DIN VDE 0116

Important Notes

Cable required for wiring to the electrode: four-core screened cable, e.g. I-Y(St) Y 2 x 2 x 0.8 or LIYCY 4 x 0.5².

Max. cable length 100 m with a conductivity from 10 $\mu\text{S}/\text{cm}$.

Max. cable length 30 m with a conductivity from 0.5 $\mu\text{S}/\text{cm}$.

Max. cable length 15 m with a conductivity from 0.5 $\mu\text{S}/\text{cm}$ when used in conjunction with inverter URN 1 (24 V d.c.).

When mounting the electrode into steam or pressurized hot-water boilers the relevant regulations must be considered.

The burner-protection circuit should be fused with 2.5 A anti-surge fuse or according to TRD regulations (e.g. 1.0 A for 75 hrs.)

The level switch itself is **not** interlocking. Interlocking and resetting have to be ensured on site by providing a secondary circuit (safety chain) in the control cabinet.

Order and Enquiry Specifications

GESTRA level switch for self-monitoring high-level alarm in accordance with TRD 602, TRD 604, EN 12952 and EN 12953:

- Level switch type NRS 1-8b in a plastic case for installation in control cabinets;

Delay of response s

Conductivity $\mu\text{S}/\text{cm}$

Mains supply V Hz

ATEX

The equipment constitutes a simple item of electrical equipment as defined in DIN EN 50020 section 5.4. According to the European Directive ATEX 94/9/EC the equipment may only be used in potentially explosive atmospheres if it is provided with approved Zener barriers.

Applicable in Ex zones 1, 2 (1999/92/EC).

The equipment does not bear a CE marking.

The suitability of the Zener barriers is certified in a separat document.


Supply in accordance with our general terms of business.

Dimensions


Base with terminals

Front view


Side view

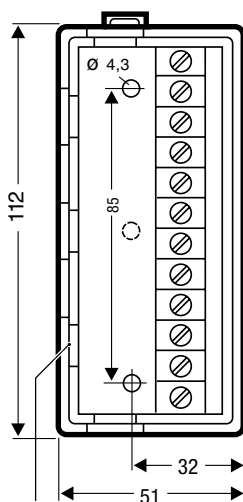

Cable entries

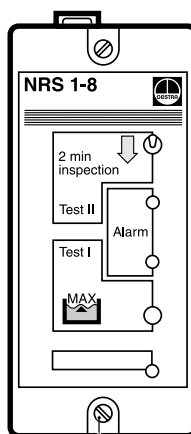


Screws to fasten cover to base

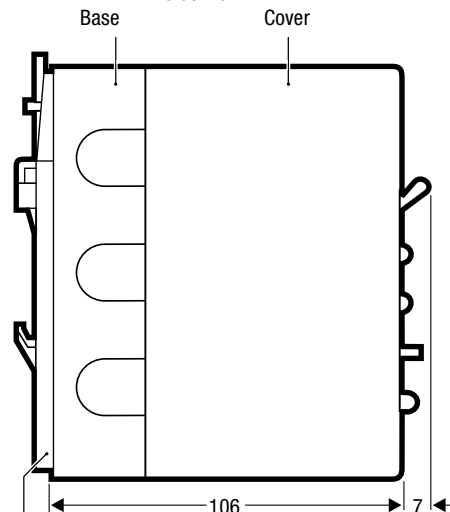


Mounting clip for 35 mm supporting rail TS 35, DIN 46277

Dimensions of level switch type NRS 1-8b

Wiring Diagrams

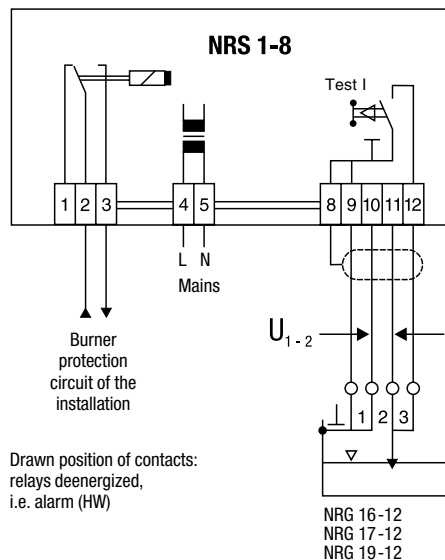

Wiring diagram for NRS 1-8
(Europe/international)

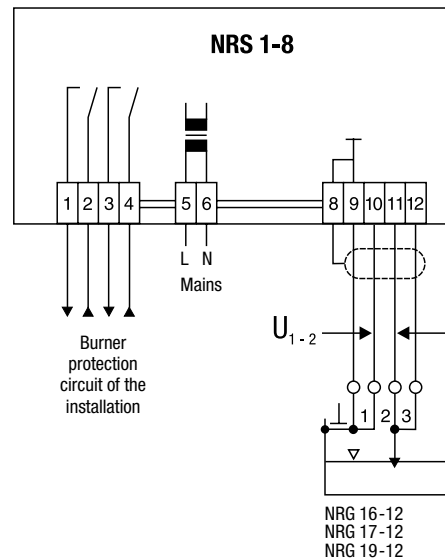

Wiring diagram for NRS 1-8
(France)

GESTRA AG

Münchener Straße 77, 28215 Bremen, Germany
Telefon +49 421 3503-0, Telefax +49 421 3503-393
E-mail info@de.gestra.com, Web www.gestra.de

